

JD 1770 NT 24 Row

Item	Part NO	Description	QTY
1	Not a PP part	Product Input Line	Dist. from input coupling to tank
2	Not a PP part	Shutoff Valves	As Needed
3	Not a PP part	Pump Supply Hose	Dist. from tank supply to pump
4	Not a PP part	System Pump	Size at 110% of max. GPM needed
5	724288*	Accumulator	1
6	724288*	Pressure Relief Valve	1
7	724033	1" Return Hose (50ft Roll)	Dist. from #6 back to product tank
8	724289 724291	Strainer Kit	1
9	Order Guide	3/8" PTC row tubing	Estimate 5-6ft. Per row
10	724100	vApplyHD Module	One per row
11	Order Guide	3/8" PTC discharge tubing	Included in #9 estimate



* Items 5 & 6 are part of the Plumbing Essentials Kit when ordered

Section Plumbing Kit Overview (Per Section Kit)

Note: Order three Section Kits and the necessary lengths of Section and Boom Hose for your setup.

Item	High Flow (724065) Greater than 15GPA	Low Flow (724083) Less than 15GPA	QTY
12	2" Manifold Section	1" Manifold Section	1
13	1" Section Hose	3/4" Section Hose	Order separately
14	1" supply to 3/4" Boom Tee	3/4" supply to 1/2" Boom Tee	1
15	3/4" Boom Hose	1/2" Boom Hose	Order separately
16	3/4" Boom x 3/8" PTC Tee	1/2" Boom x 3/8" PTC Tee	6
17	3/4" Boom x 3/8" PTC 90deg	1/2" Boom x 3/8" PTC 90deg	2

Legend Detail For Boom Connections

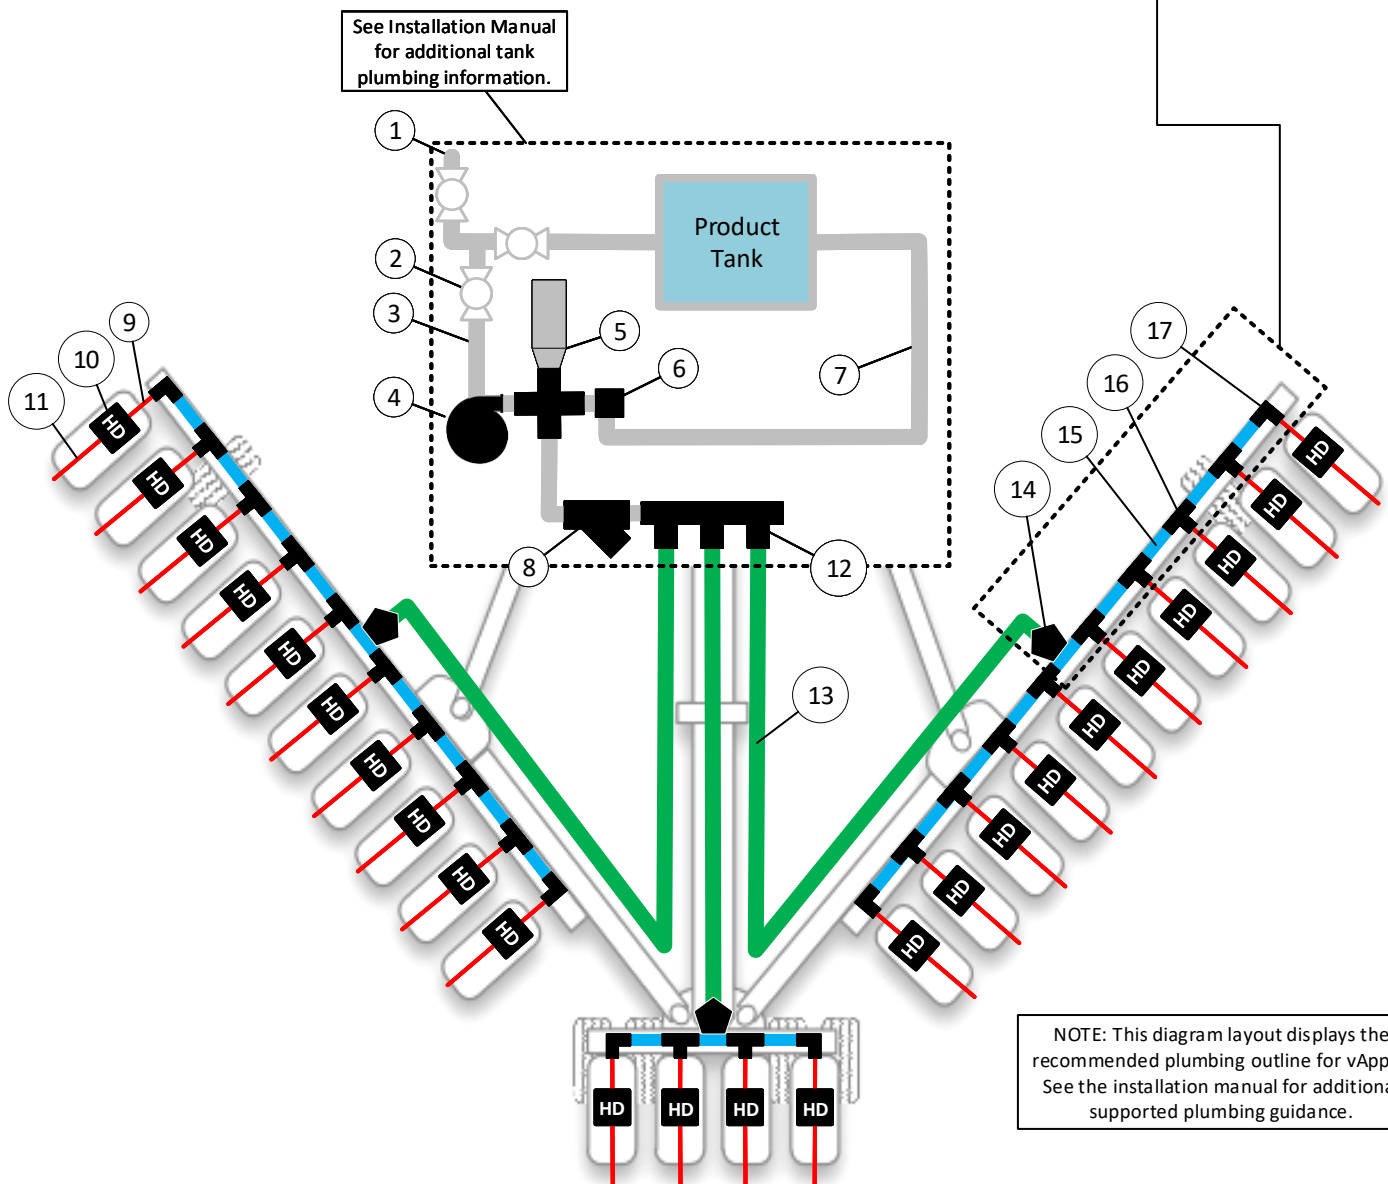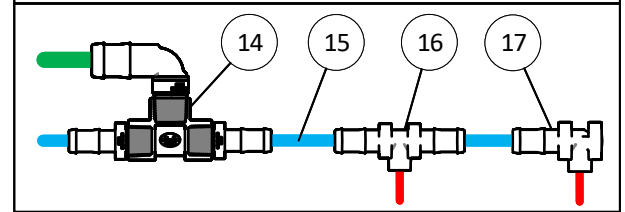

JD 1770 NT 24 Row

Item	Part NO	Description	QTY
1	Not a PP part	Product Input Line	Dist. from input coupling to tank
2	Not a PP part	Shutoff Valves	As Needed
3	Not a PP part	Pump Supply Hose	Dist. from tank supply to pump
4	Not a PP part	System Pump	Size at 110% of max. GPM needed
5	724288*	Accumulator	1
6	724288*	Pressure Relief Valve	1
7	724033	1" Return Hose (50ft Roll)	Dist. from #6 back to product tank
8	724289 724291	Strainer Kit	1
9	Order Guide	3/8" PTC row tubing	Estimate 10ft. Per row
10	724100	vApplyHD Module	One per Section
11	Order Guide	3/8" PTC discharge tubing	Included in #9 estimate

* Items 5 & 6 are part of the Plumbing Essentials Kit when ordered



Section Plumbing Kit Overview (Per Section Kit)

Note: Order three Section Kits and the necessary lengths of Section and Boom Hose for your setup.

Item	High Flow (724065) Greater than 15GPA	Low Flow (724083) Less than 15GPA	QTY
12	2" Manifold Section	1" Manifold Section	1
13	1" Section Hose	3/4" Section Hose	Order separately
14	1" supply to 3/4" Boom Tee	3/4" supply to 1/2" Boom Tee	1
15	3/4" Boom Hose	1/2" Boom Hose	Order separately
16	3/4" Boom x 3/8" PTC Tee	1/2" Boom x 3/8" PTC Tee	6
17	3/4" Boom x 3/8" PTC 90deg	1/2" Boom x 3/8" PTC 90deg	2

In the event that Section Kits are not purchased, only items 16 & 17 can be ordered individually from Precision Planting. Source other fittings locally.

Legend Detail For Boom Connections

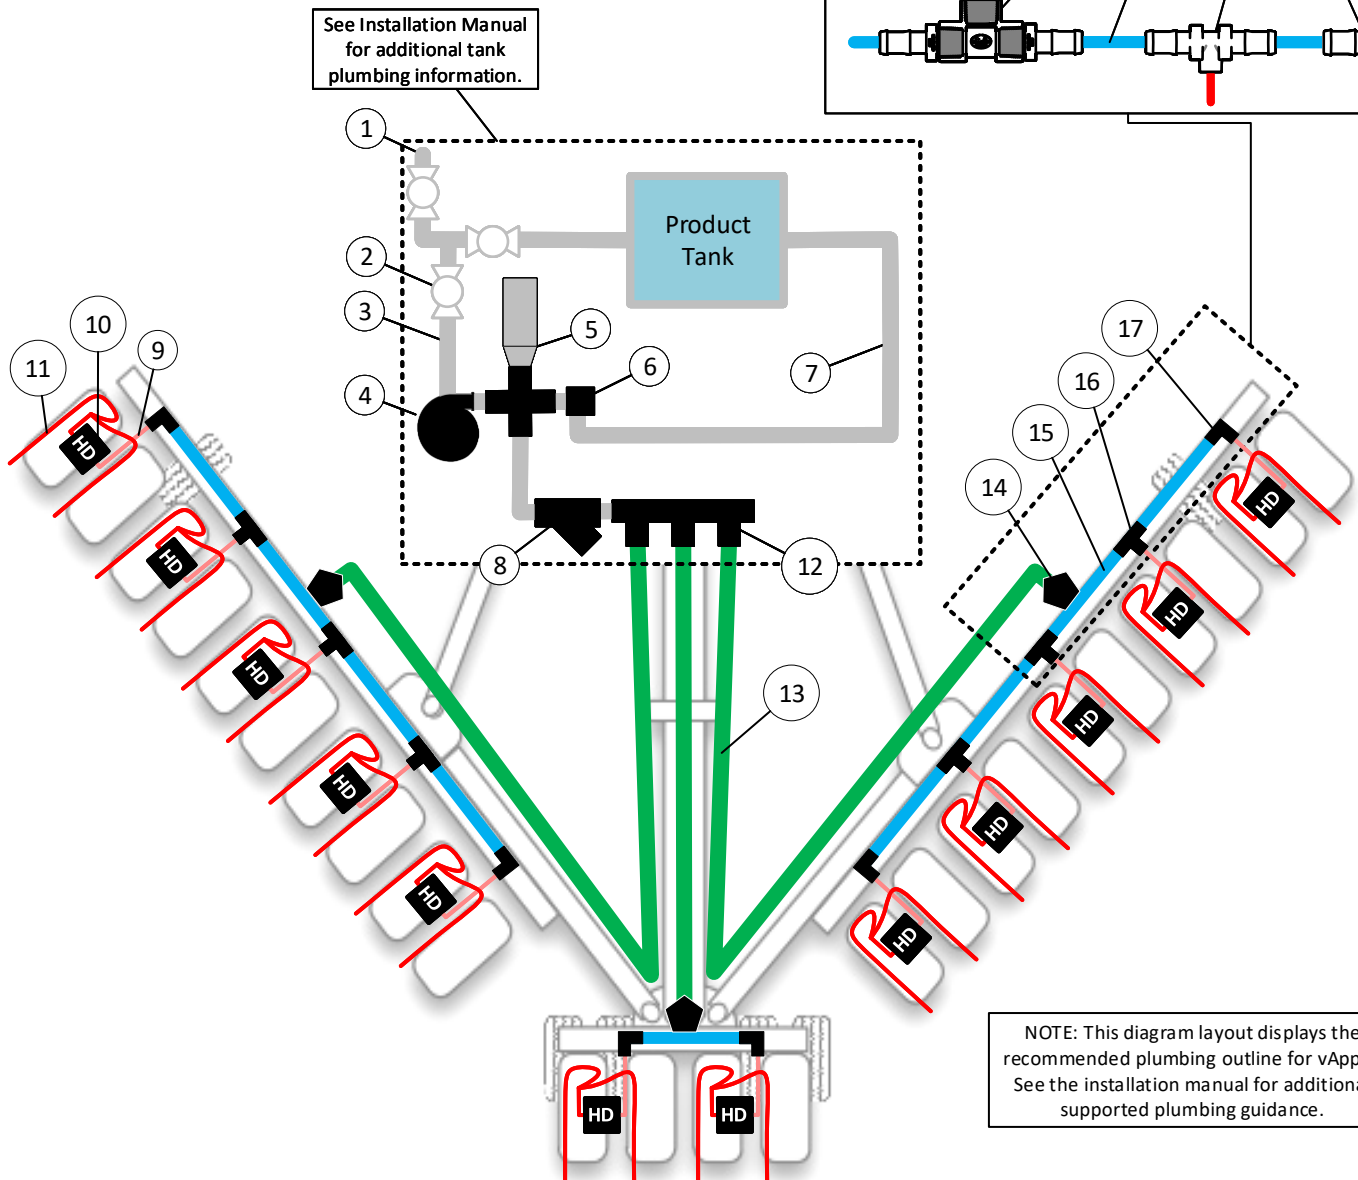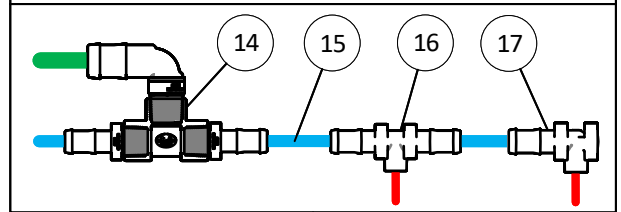

NOTE: This diagram layout displays the recommended plumbing outline for vApply. See the installation manual for additional supported plumbing guidance.

JD 1770 NT 24 Row

Item	Part NO	Description	QTY
1	Not a PP part	Product Input Line	Dist. from input coupling to tank
2	Not a PP part	Shutoff Valves	As Needed
3	Not a PP part	Pump Supply Hose	Dist. from tank supply to pump
4	Not a PP part	System Pump	Size at 110% of max. GPM needed
5	724288*	Accumulator	1
6	724288*	Pressure Relief Valve	1
7	724033	1" Return Hose (50ft Roll)	Dist. from #6 back to product tank
8	724289 724291	Strainer Kit	1
9	Order Guide	3/8" PTC row tubing	Estimate 10ft. Per row
10	724100	vApplyHD Module	One per Section
11	Order Guide	3/8" PTC discharge tubing	Included in #9 estimate

* Items 5 & 6 are part of the Plumbing Essentials Kit when ordered



Section Plumbing Kit Overview (Per Section Kit)

Note: Order three Section Kits and the necessary lengths of Section and Boom Hose for your setup.

Item	High Flow (724065) Greater than 15GPA	Low Flow (724083) Less than 15GPA	QTY
12	2" Manifold Section	1" Manifold Section	1
13	1" Section Hose	3/4" Section Hose	Order separately
14	1" supply to 3/4" Boom Tee	3/4" supply to 1/2" Boom Tee	1
15	3/4" Boom Hose	1/2" Boom Hose	Order separately
16	3/4" Boom x 3/8" PTC Tee	1/2" Boom x 3/8" PTC Tee	6
17	3/4" Boom x 3/8" PTC 90deg	1/2" Boom x 3/8" PTC 90deg	2

In the event that Section Kits are not purchased, only items 16 & 17 can be ordered individually from Precision Planting. Source other fittings locally.

Legend Detail For Boom Connections

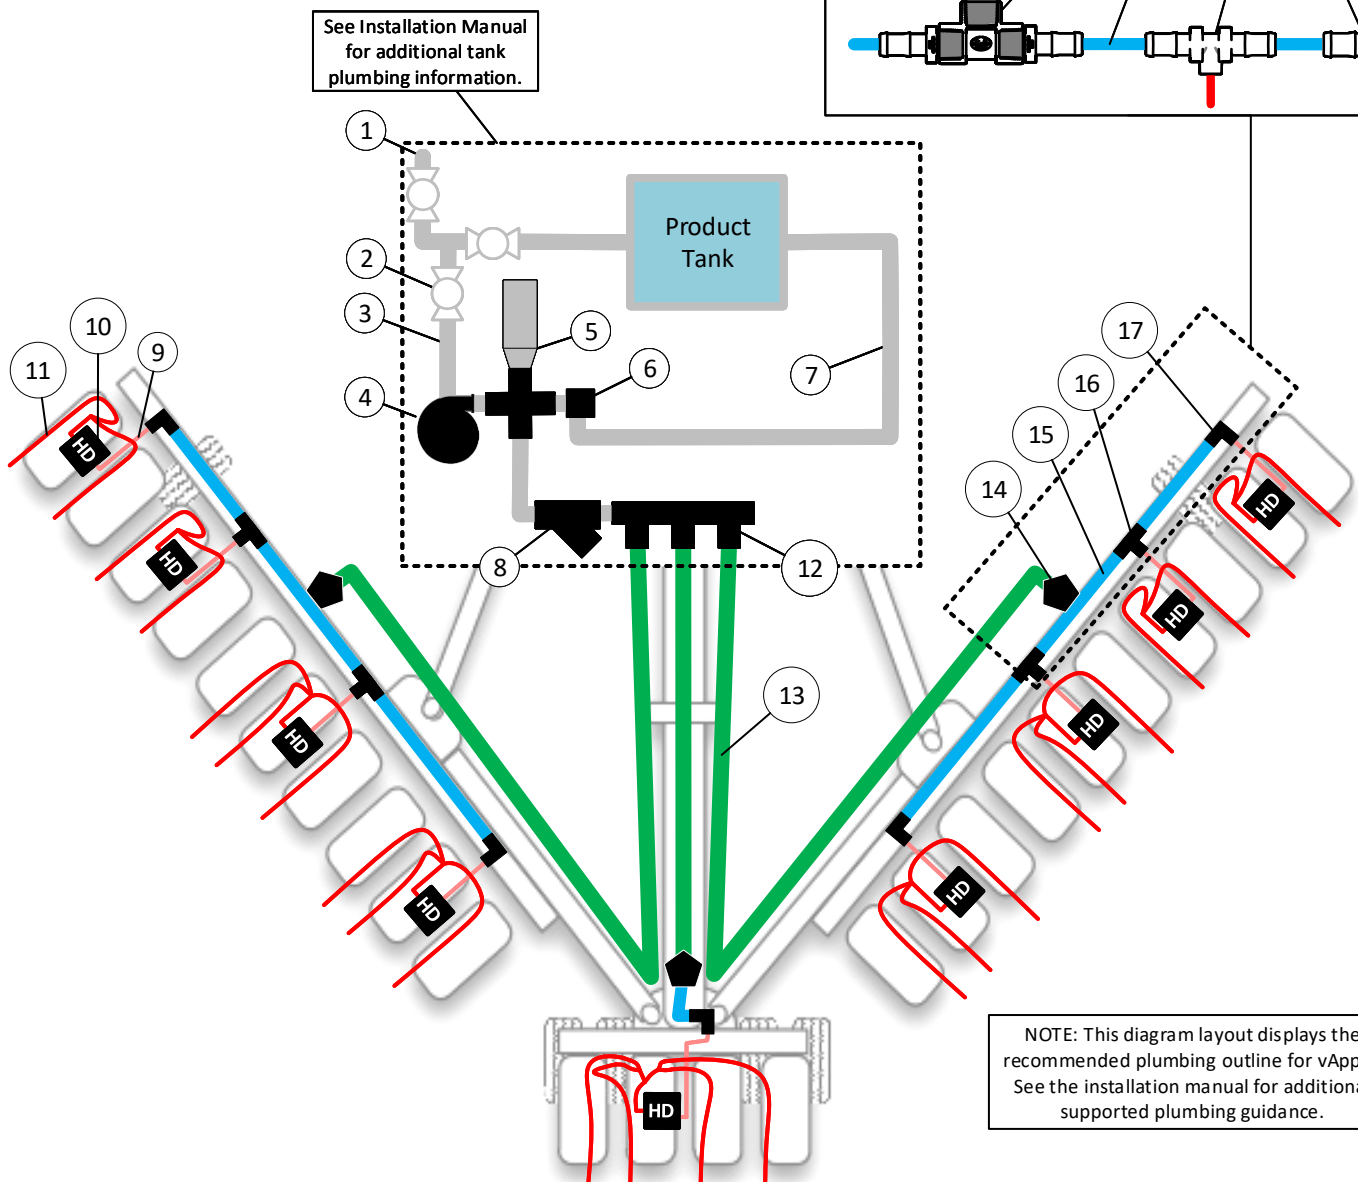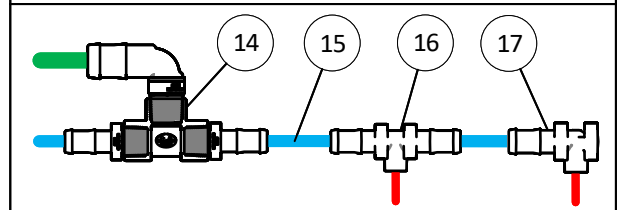

JD 1770 NT 24 Row

Item	Part NO	Description	QTY
1	Not a PP part	Product Input Line	Dist. from input coupling to tank
2	Not a PP part	Shutoff Valves	As Needed
3	Not a PP part	Pump Supply Hose	Dist. from tank supply to pump
4	Not a PP part	System Pump	Size at 110% of max. GPM needed
5	724288*	Accumulator	1
6	724288*	Pressure Relief Valve	1
7	724033	1" Return Hose (50ft Roll)	Dist. from #6 back to product tank
8	724289 724291	Strainer Kit	1
9	Order Guide	3/8" PTC row tubing	Estimate 10ft. Per row
10	724100	vApplyHD Module	One per Section
11	Order Guide	3/8" PTC discharge tubing	Included in #9 estimate

* Items 5 & 6 are part of the Plumbing Essentials Kit when ordered



Section Plumbing Kit Overview (Per Section Kit)

Note: Order three Section Kits and the necessary lengths of Section and Boom Hose for your setup.

Item	High Flow (724065) Greater than 15GPA	Low Flow (724083) Less than 15GPA	QTY
12	2" Manifold Section	1" Manifold Section	1
13	1" Section Hose	3/4" Section Hose	Order separately
14	1" supply to 3/4" Boom Tee	3/4" supply to 1/2" Boom Tee	1
15	3/4" Boom Hose	1/2" Boom Hose	Order separately
16	3/4" Boom x 3/8" PTC Tee	1/2" Boom x 3/8" PTC Tee	6
17	3/4" Boom x 3/8" PTC 90deg	1/2" Boom x 3/8" PTC 90deg	2

In the event that Section Kits are not purchased, only items 16 & 17 can be ordered individually from Precision Planting. Source other fittings locally.

Legend Detail For Boom Connections

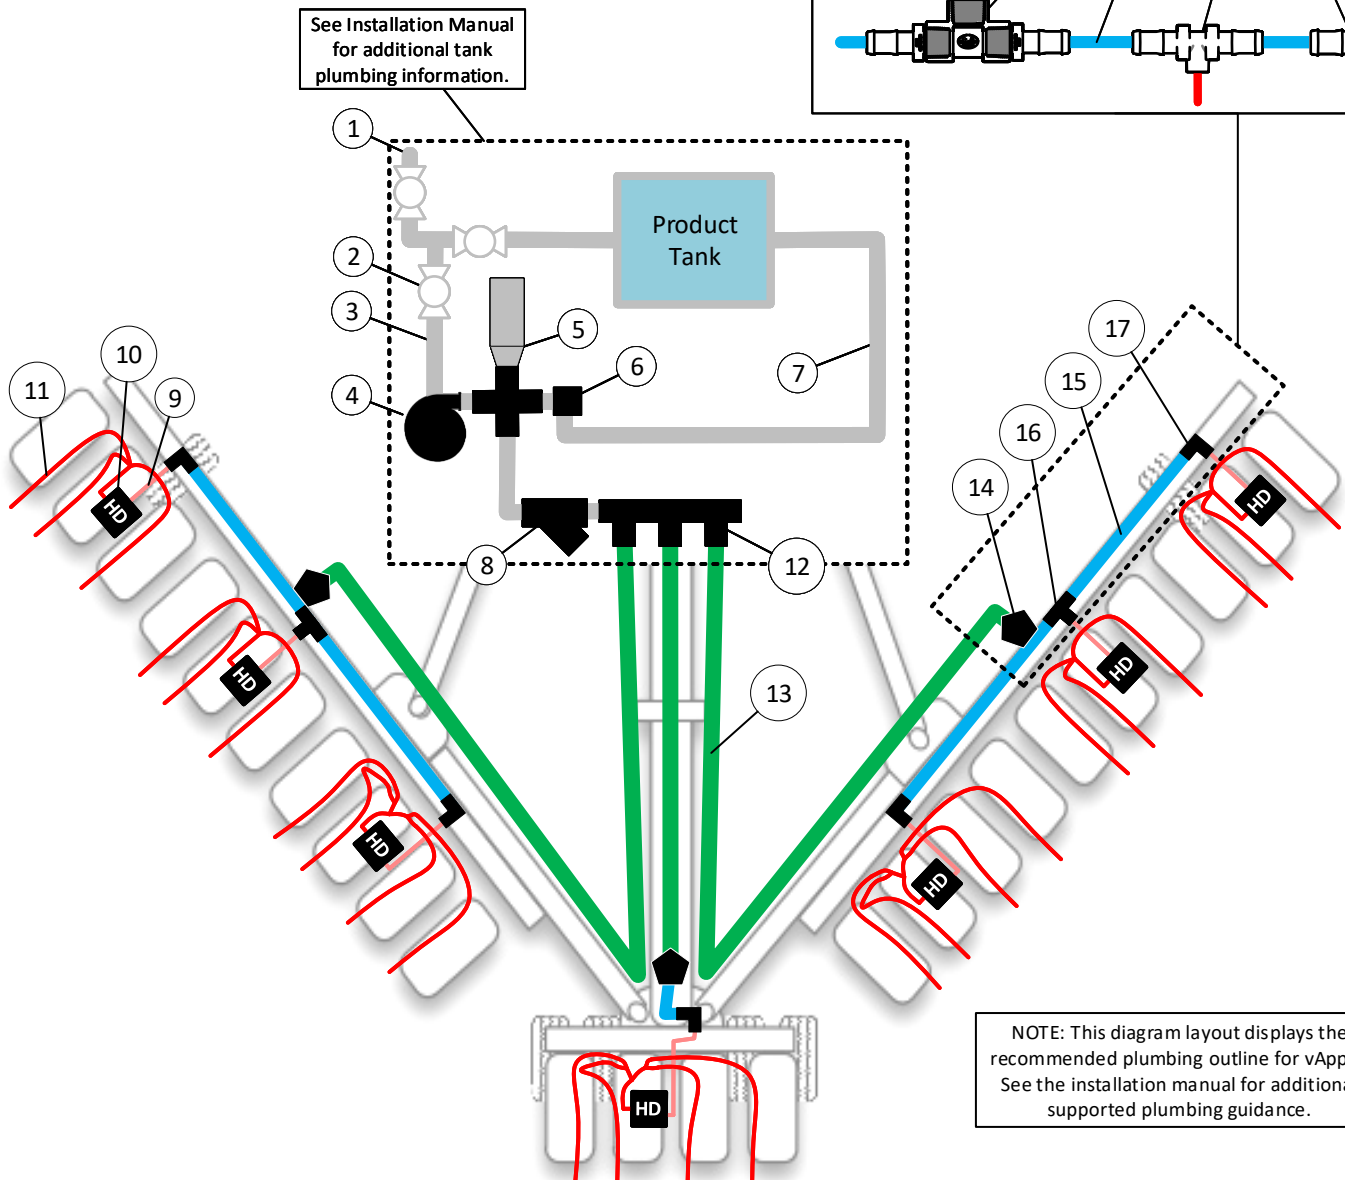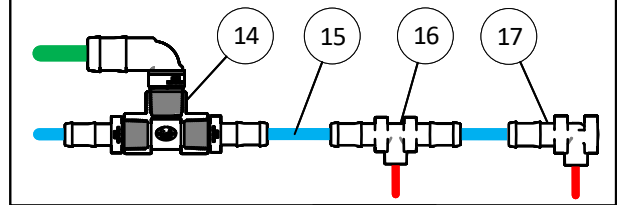

NOTE: This diagram layout displays the recommended plumbing outline for vApply. See the installation manual for additional supported plumbing guidance.